



FRONT VIEW

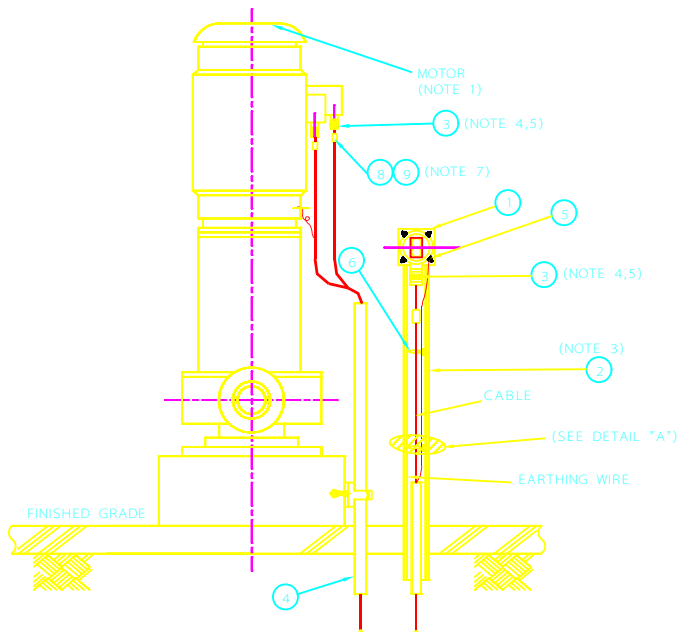

SIDE VIEW

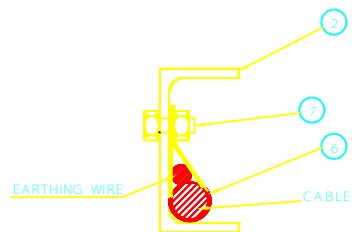

DETAIL "A"

NOTES

- 1- FOR CABLE TERMINATION, REFER TO DWG. No. EL-206
- 2- FOR STANCHION OF CONTROL STATION, REFER TO DWG. No. EL-216
- 3- FOR INSTALLATION OF CONTROL STATION, REFER TO DWG. No. EL-217
- 4- FOR SELECTION OF CABLE GLAND, REFER TO THE SELECTION CHART IN DWG. No. EL-219
- 5- REFER TO THE RELEVANT CABLE SCHEDULE FOR THE CABLE SIZES.
- 6- FOR STUB UP OF RIGID STEEL CONDUIT AT GRADE. REFER TO DWG. No. EL-205
- 7- FOR CABLE IDENTIFICATION NUMBER, REFER TO DWG. No. EL-207
- 8- FOR CONDUIT SIZES, REFER TO "CONDUIT SELECTION CHART" IN DWG. No. EL-218
- 9- FOR CONDUIT SUPPORT, REFER TO DWG. No. EL-211

No.	DESCRIPTION	QTY.
1	CONTROL STATION	1-EA
2	STANCHION ([-100x50x5])	1-EA
3	CABLE GLAND	2-EA
4	RIGID STEEL CONDUIT	AS REQD
5	BOLT AND NUT WITH 1-SPRING WASHER & 2-FLAT WASHERS	4-EA
6	CABLE CLIP (ALL STRIP WITH PVC SKIN)	2-POINT
7	M6x20L BOLT AND NUT WITH 1-SPRING WASHER & 2-FLAT WASHERS	2-SET
8	CABLE I.D. NUMBER TAG PLATE	2-EA
9	FIXING TIE FOR TAG PLATE	4-EA

REV	DESCRIPTION	DATE
C		
B		
A		

IRANIAN PETROLEUM STANDARDS 

NO REVISION PERMITTED UNLESS APPROVED BY STANDARD ORGANIZATION

REFERENCE DRAWING
POWER INSTALLATION DETAILS
"CATEGORY 200"
MV MOTOR (VERTICAL)

DATE	DRAWING No.	SHEET	REV.
	IPS - D - EL - 202	1	1