


FRONT VIEW

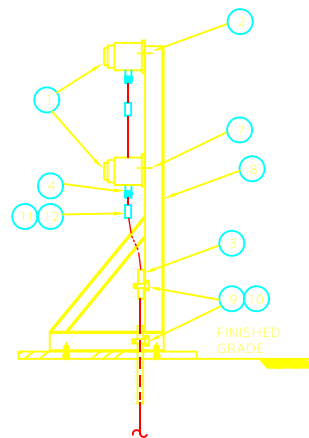

SIDE VIEW

NOTES

- 1- FOR CABLE SIZES REFER TO THE RELEVANT CABLE SCHEDULE.
- 2- FOR CABLE ID NUMBER REFER TO DWG. EL - 207
- 3- SEE DWG. No.EL-211 FOR UNISTRUT CHANNEL AND CLAMP DETAILS.

No.	DESCRIPTION	QTY.
1	CONTROL STATION	AS REQD.
2	BOLT & NUT WITH 1-SPRING & 2-FLAT WASHERS	AS REQD.
3	RIGID STEEL CONDUIT	AS REQD.
4	CABLE GLAND	AS REQD.
5	MASONRY ANCHR WITHOUT STUD	AS REQD.
6	BOLT WITH 1-SPRING & 1-FLAT WASHER	AS REQD.
7	SUPPORT ANGLE (L-50x50x5)	AS REQD.
8	SUPPORT CHANNEL ([-100x50x5])	AS REQD.
9	UNISTRUT CHANNEL (40x30x10x2.5)	AS REQD.
10	UNISTRUT CLAMP WITH BOLT AND NUT	AS REQD.
11	CABLE ID NUMBER AND TAG PLATE	AS REQD.
12	FIXING TIE	AS REQD.

REV	DESCRIPTION	DATE
C		
B		
A		

IRANIAN PETROLEUM STANDARDS 
 NO REVISION PERMITTED UNLESS APPROVED BY STANDARD ORGANIZATION

REFERENCE DRAWING
 POWER INSTALLATION DETAILS
 "CATEGORY 200"
 MULTIPLE CONTROL STATION

DATE	DRAWING No.	SHEET	REV.
	IPS - D - EL - 213	1	1